


W3. 31mxL5. 79mxH2. 86m

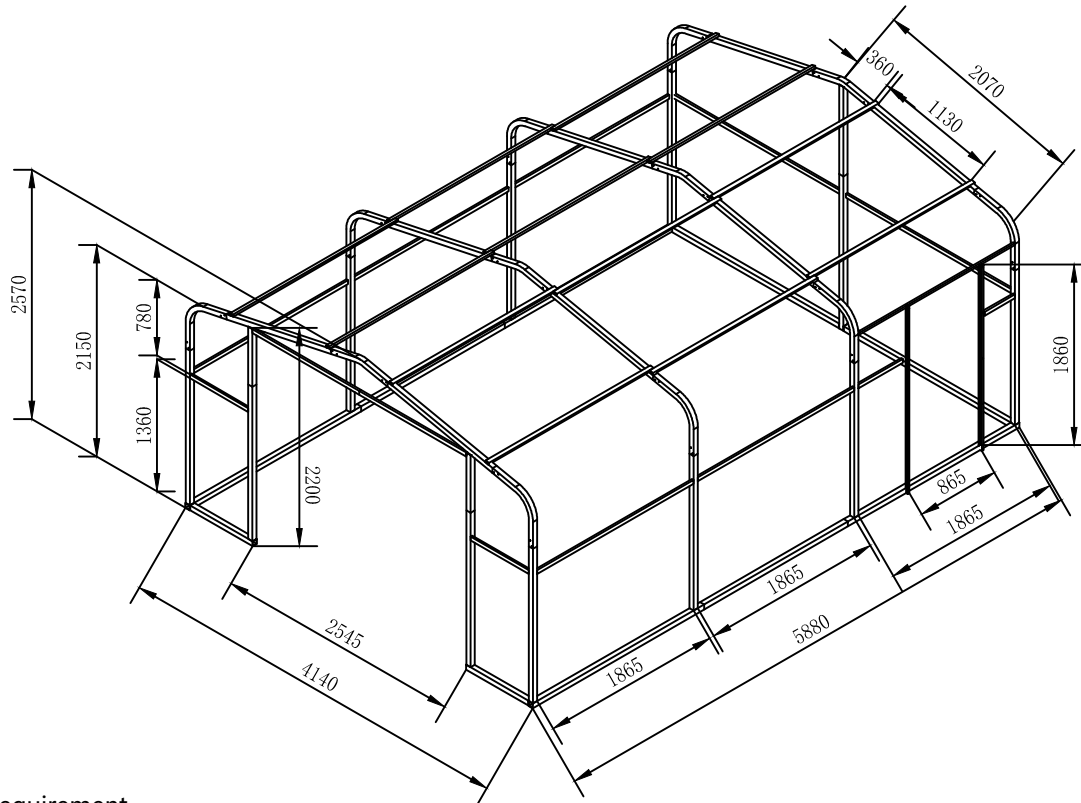


Technical Requirement

1. The main steel tube and supports are processed by galvanized coating(50*50*1.5mm Steel Tube & 20*40*1.5mm)
2. The sheets are made of thickness 0.32mm coated galvanized steel;
3. Other connection with hot dip galvanized
4. The main steel frame are connected with high strength screws (ST 4.8*16mm);
5. The bottom part is fixed with high strength bolts(M8*80mm)
- 6.It is recommended to install it on the cement floor. The size of the cement foundation is not less than 4260 ×6000.

Unit:mm

Frame Sketch

SG1419-H215

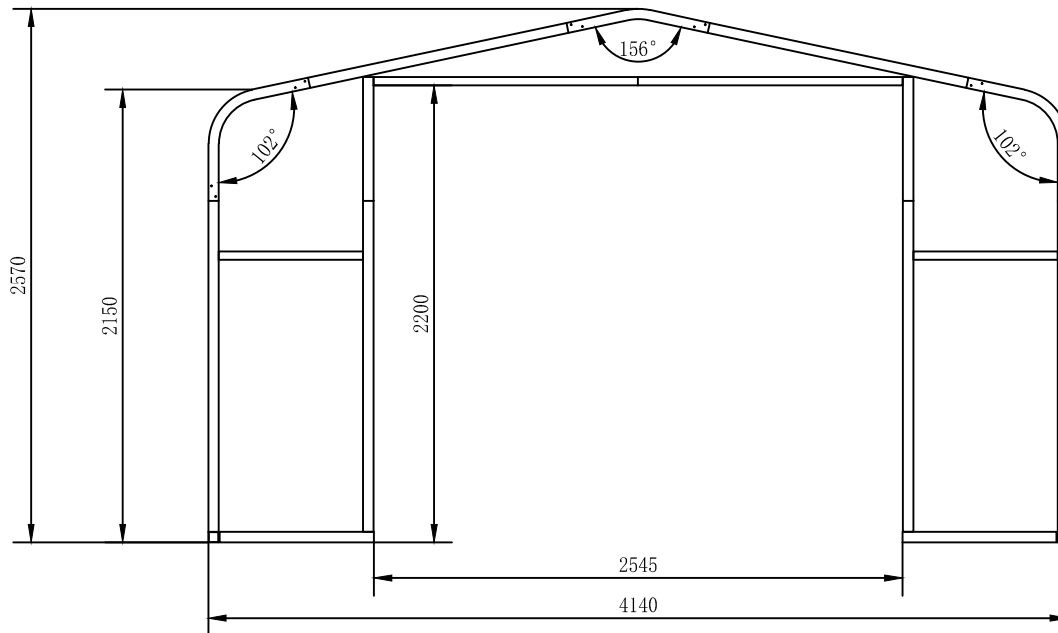

Technical Requirement

1. The main steel tube and supports are processed by galvanized coating(50*50*1.5mm Steel Tube & 20*40*1.5mm)
2. The sheets are made of thickness 0.32mm coated galvanized steel;
3. Other connection with hot dip galvanized
4. The main steel frame are connected with high strength screws (ST 4.8*16mm);
5. The bottom part is fixed with high strength bolts(M8*80mm)
- 6.It is recommended to install it on the cement floor. The size of the cement foundation is not less than 4260 x6000.

Unit:mm

Frame Sketch

SG1419-H215